



PLAN

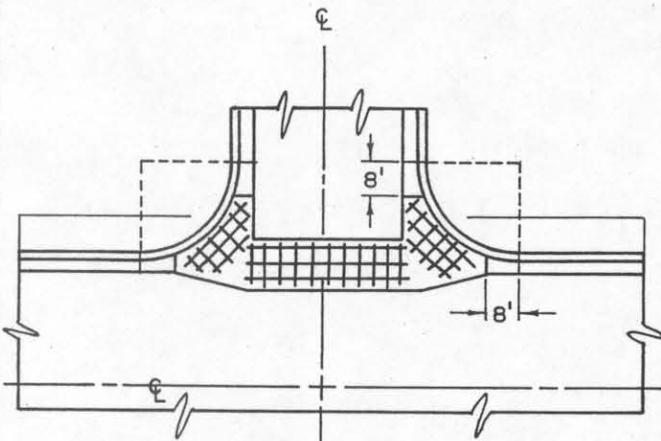

PLAN VIEW SHOWING STEEL LAYOUT

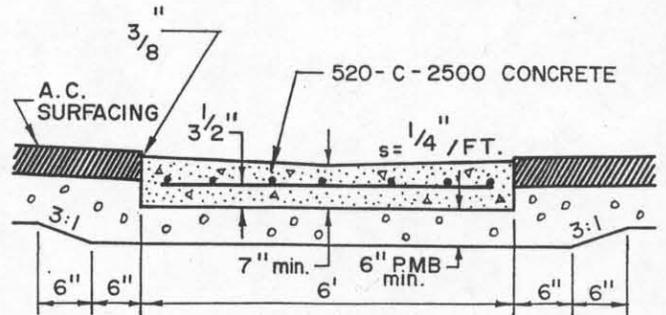

GUTTER CROSS-SECTION

NOTES

1. THICKNESS LESS THAN 8", INSTALL No. 4 REINFORCING STEEL AT 12" BOTH WAYS IN ALL CROSS GUTTERS AND SPANDRELS.
2. CROSS GUTTERS TO BE USED ONLY WHERE VEHICLES NORMALLY STOP. DRAINAGE WATER TO BE TAKEN UNDERGROUND AT INTERSECTIONS ACROSS THRU TRAVELED ROADS.
3. "SPECIAL CROSS GUTTER" STANDARD SHALL BE USED WHEN $G_1 \geq 2.5\%$ & $G_2 \geq .5\%$.

REV.	DATE	BY	CITY OF CAMARILLO ENGINEERING DIVISION		STANDARD CROSS GUTTER	DRWG. NO.
			DRAWN BY RN	DATE 7-86		FILED
			CHECKED BY SM	SCALE N.T.S.		SHT 1 OF 1
			APPD. BY <i>David S. Williams</i> CIVIL ENGR.	APPD. BY <i>Daniel J. Bradley</i> DIR. ENG. SERVICES		